


Detail Soils Evaluation 75-acres, Chatham County, NC Standout Properties Pennington Tract South

Legend

-  Areas contain soils with 30 inches or more of useable material and have potential for conventional or modified conventional septic systems. There will be areas of soils in this mapping unit that will require LPP instead of conventional septic systems.
-  Areas contain soils with 24 to 29 inches of useable material and have potential LPP or ultra-shallow conventional septic systems.
- UN** Unsuitable areas.
- FILL** Unsuitable areas due to Fill Material on-site.

- *Detail Soils Evaluation
- *Soil boundary was flagged in the field and located via GPS receivers
- *Not a Survey.
- *Septic system setbacks listed below for new lots.
- 1) 10' from property lines.
- 2) 100' from wells for primary systems.
- 3) 50' from wells for repair systems.
- 4) 50' from surface waters (streams, ponds, lakes).
- *Due to variable soils located on-site, there may be small inclusions of unsuitable soils located in the areas mapped as suitable.
- *See accompanying report for additional information.
- *Base map taken from Chatham County GIS, not a survey map.

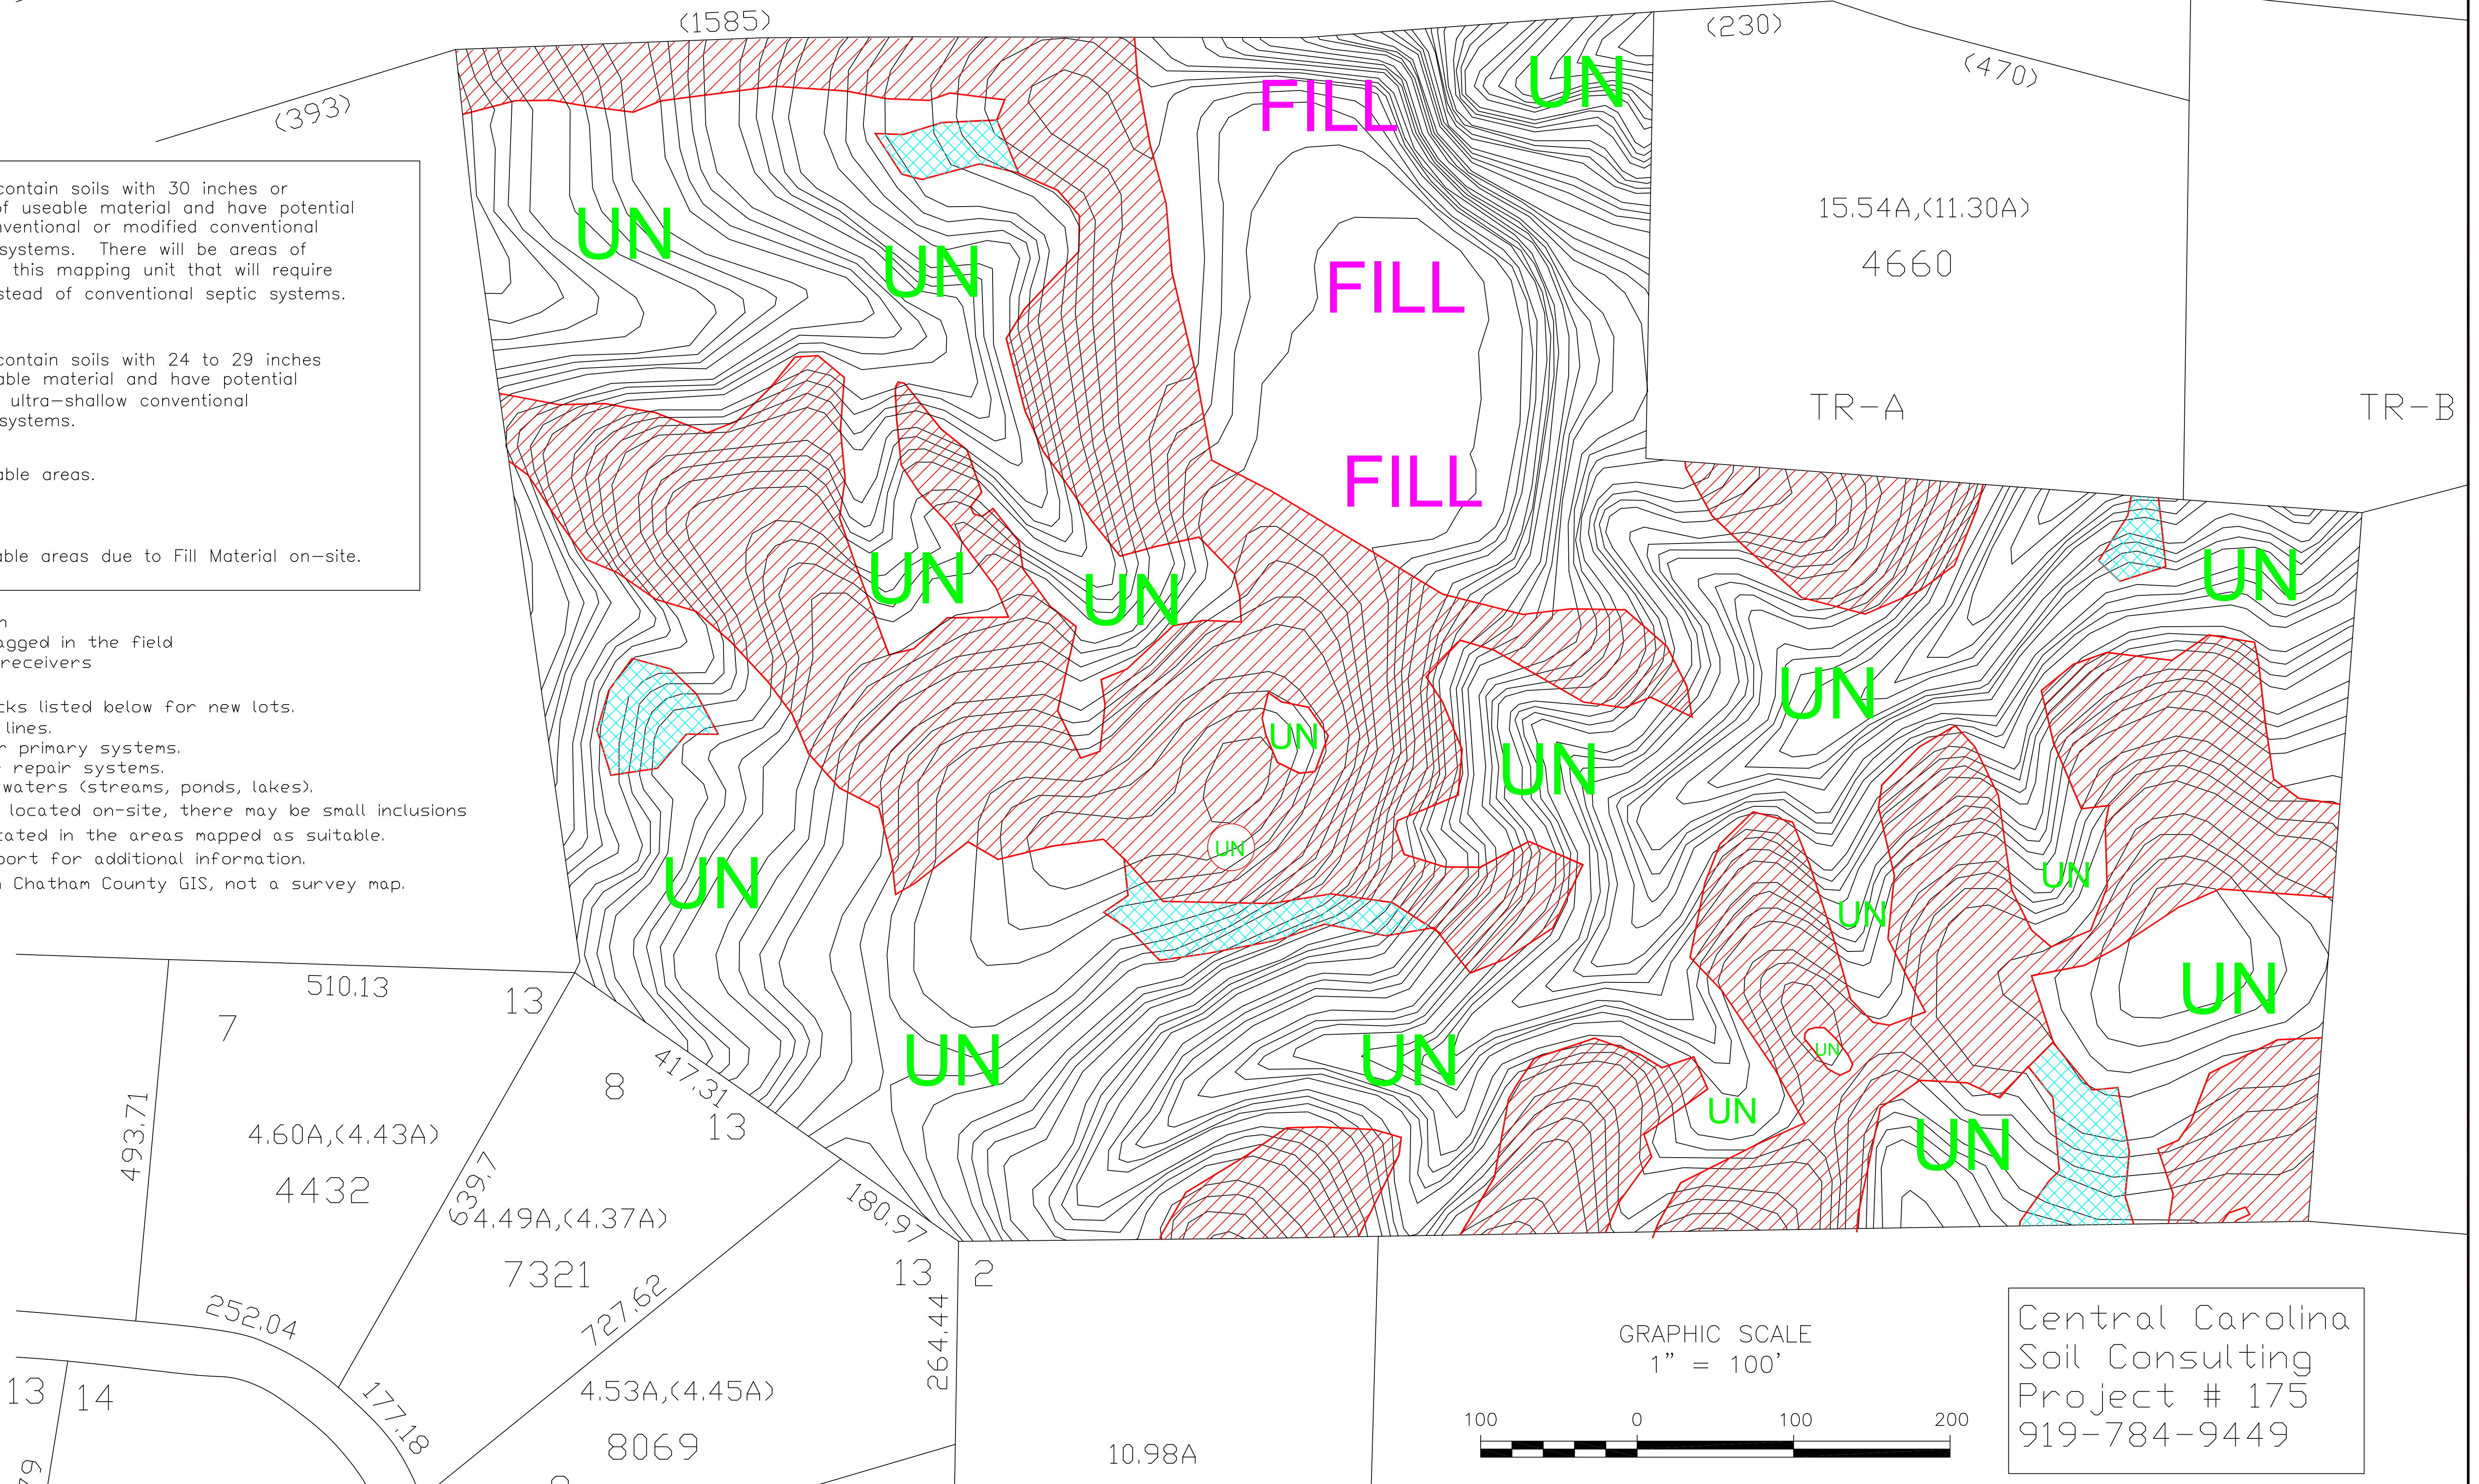

Central Carolina
Soil Consulting
Project # 175
919-784-9449